


CHICKASAW ELEC. SPECIFICATION FOR UNDERGROUND SECONDARY METERING

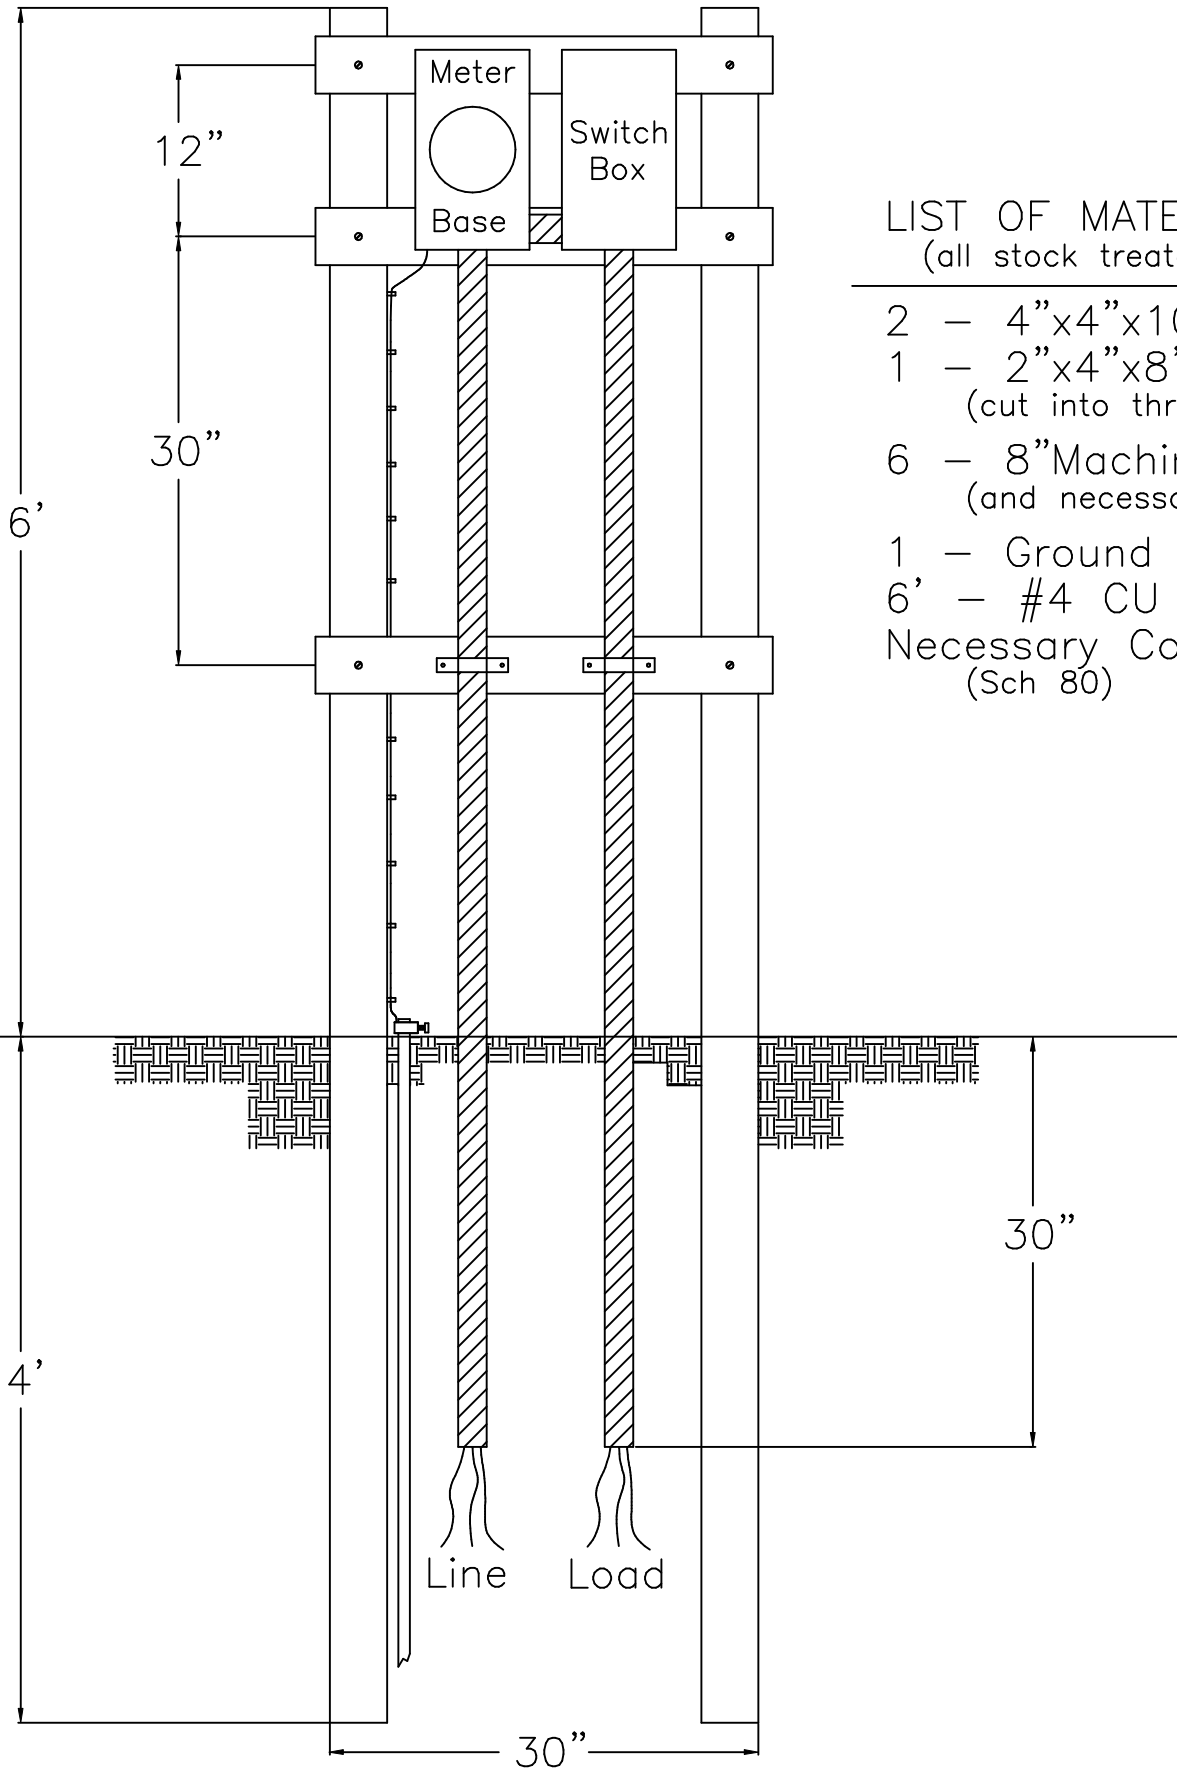

LIST OF MATERIALS (all stock treated timber)

-
- 2 - 4"x4"x10'
 - 1 - 2"x4"x8'
(cut into three pieces)
 - 6 - 8" Machine Bolts
(and necessary hardware)
 - 1 - Ground Rod
 - 6' - #4 CU
 - Necessary Conduit
(Sch 80)